



\\ng\PVWC References Drive\0\_Master Documents and Forms\4\_Construction Details\cad\water details.dwg, 10/28/2020 3:08:52 PM

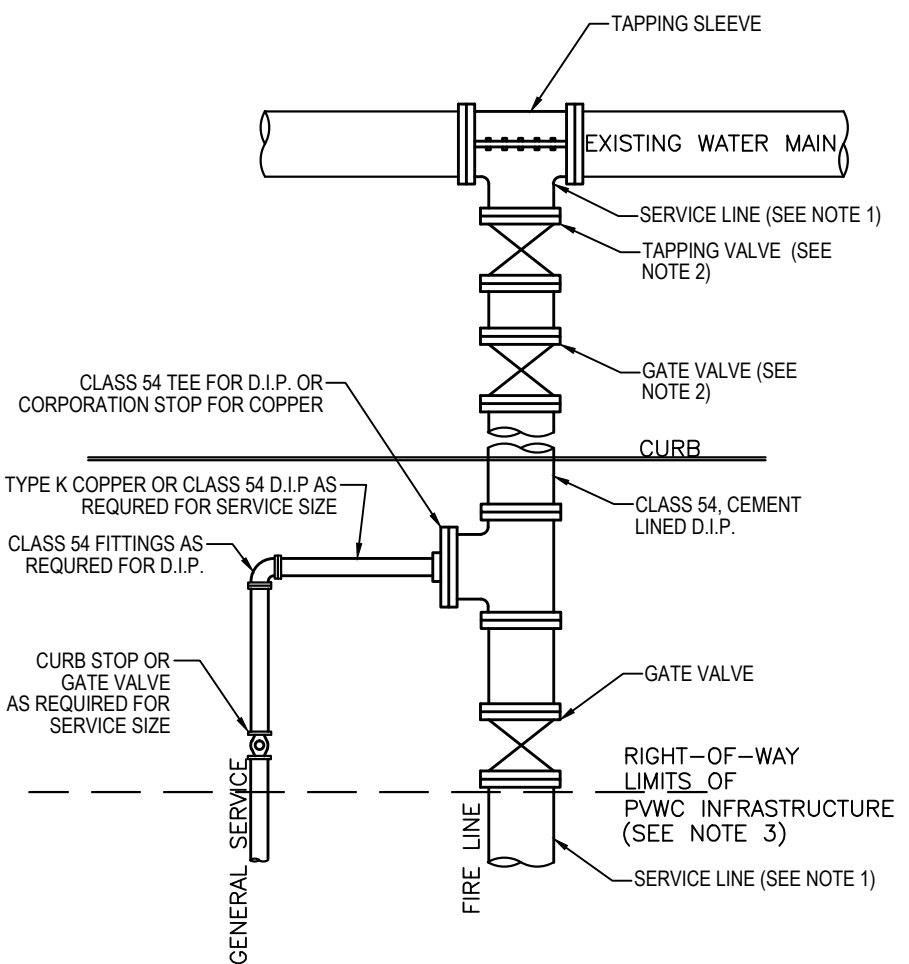

TAPPING SLEEVE AND VALVE

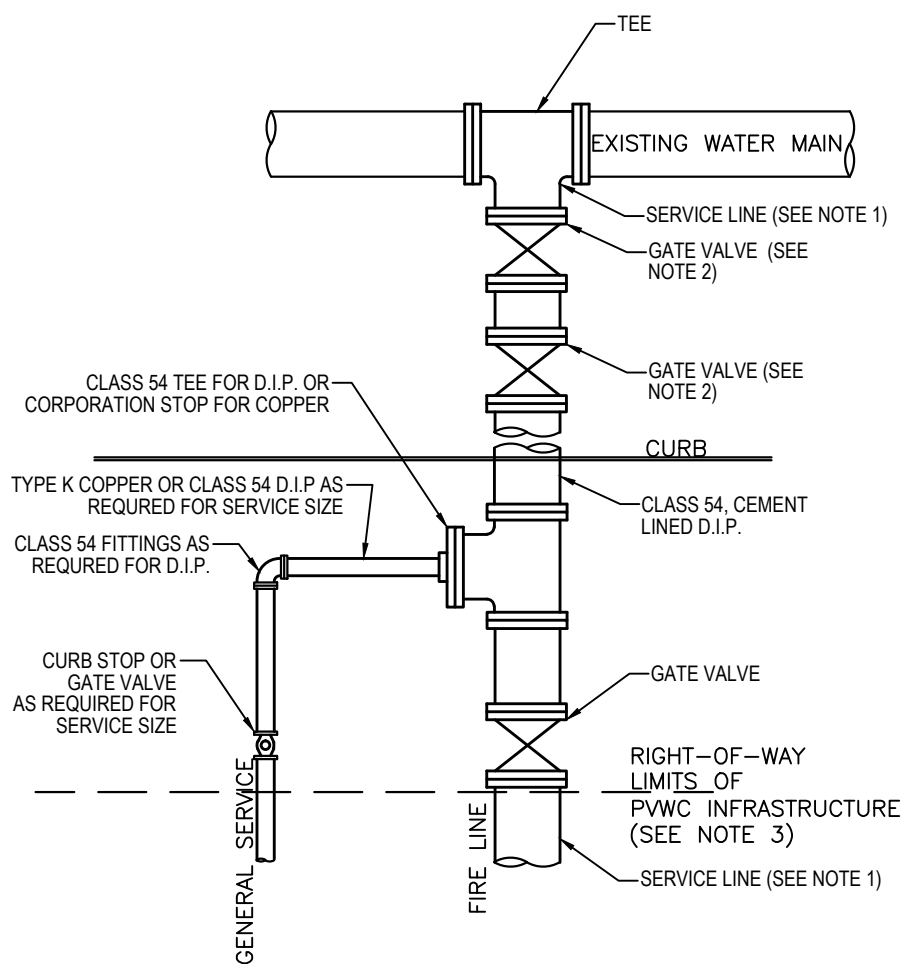

CUT-IN TEE

- MATERIALS:**
1. TAPPING SLEEVE: SMITH BLAIR TYPE 664 STAINLESS STEEL TAPPING SLEEVE.
  2. TAPPING VALVE: MUELLER T-2361 SERIES.
  3. GATE VALVE: MUELLER A-2361 SERIES.
  4. VALVE BOX: BINGHAM AND TAYLOR FIGURE NUMBER 4908.
  5. SEE WATER SERVICE CONNECTION UP TO 2" DETAIL FOR COPPER SERVICE MATERIALS.
  6. CLIFTON, PASSAIC, PATERSON, PROSPECT PARK: OPEN CLOCKWISE (RIGHT)
  7. NORTH ARLINGTON, LODI, WEST MILFORD: OPEN COUNTER-CLOCKWISE (LEFT)

- NOTES:**
1. TAP OR TEE SHALL BE 4" MIN. A REDUCER SHALL BE CONSTRUCTED AFTER THE GATE VALVE AT THE RIGHT-OF-WAY FOR 2-1/2" OR 3" SERVICES.
  2. FOR EXISTING MAINS 16-INCHES OR GREATER IN DIAMETER, THE TAPPING VALVE / GATE VALVE SHALL BE BURIED AND A SECOND GATE VALVE SHALL BE CONSTRUCTED.
  3. THERE SHALL BE NO INTERCONNECTION BETWEEN THE GENERAL SERVICE AND THE FIRE LINE AND NO CONNECTION OF THE GENERAL SERVICE TO THE FIRE LINE AFTER THE CURB STOP OR GATE VALVE.

**GENERAL AND FIRE SERVICE**  
(NOT TO SCALE)

<b>PASSAIC VALLEY WATER COMMISSION</b>		
1525 MAIN AVE. CLIFTON, N.J. TEL:(973) 340-4300		
<b>GENERAL AND FIRE SERVICE</b>		
<b>TYPICAL DETAIL</b>		
DESIGNED BY:		DATE: 10/28/20
DRAWN BY: M.R/PAD		SCALE: NOT TO SCALE
CHECKED BY:		DWG. 1 OF 1